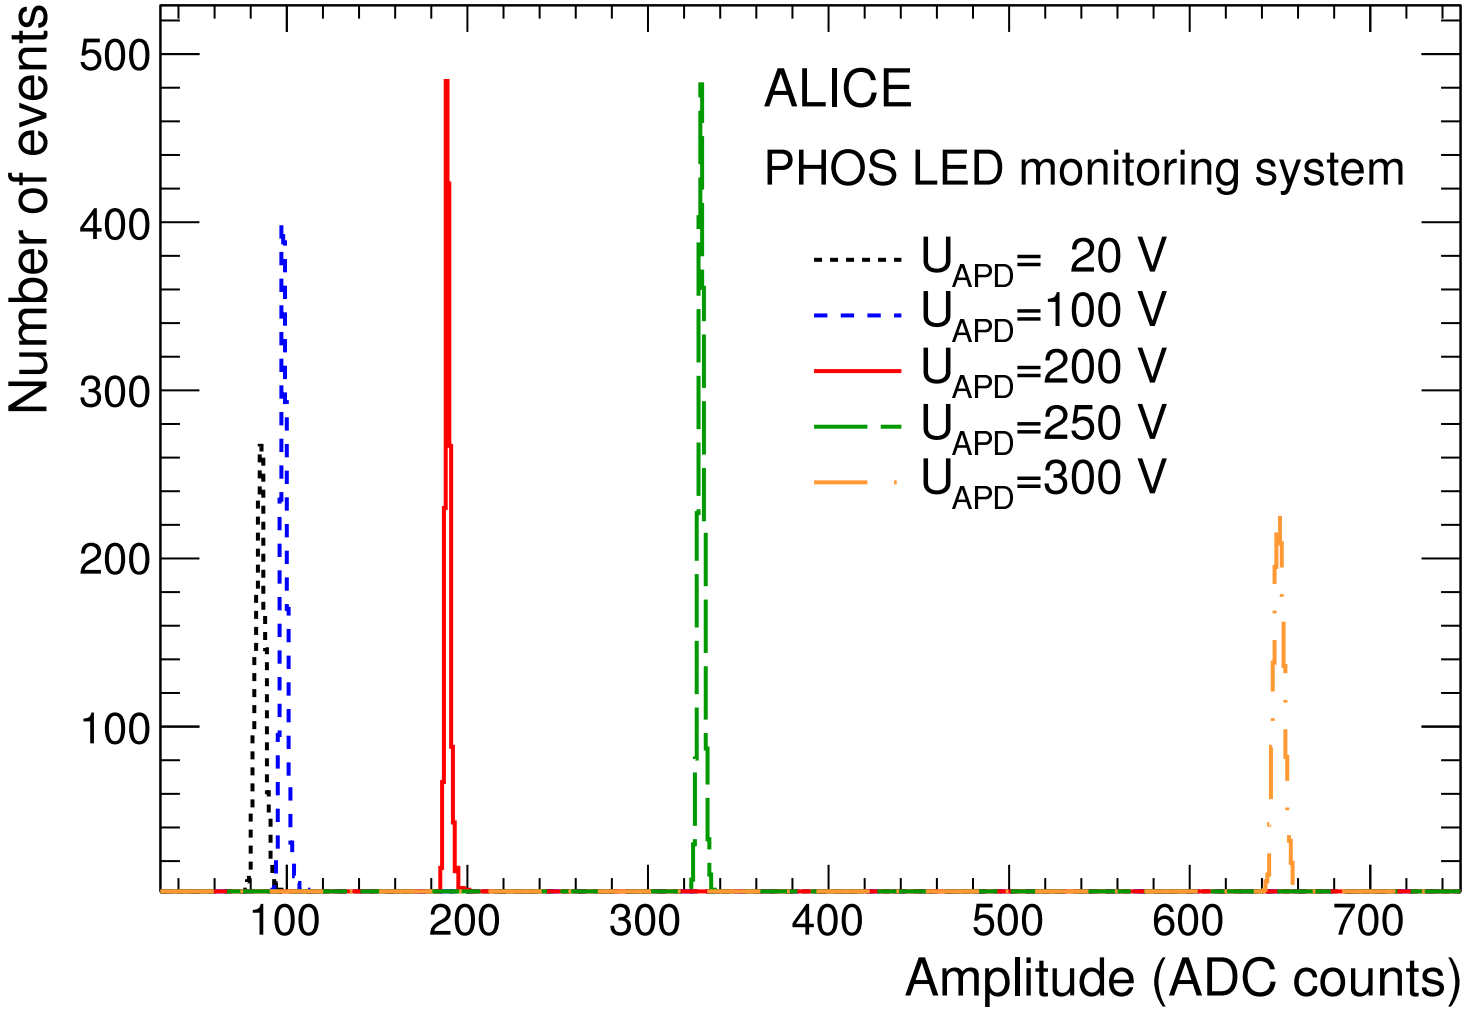
ALICE
PHOS LED monitoring system
U_APD= 20 V
U_APD=100 V
U_APD=200 V
U_APD=250 V
U_APD=300 V
Number of events
Amplitude (ADC counts)
100
200
300
400
500
600
700